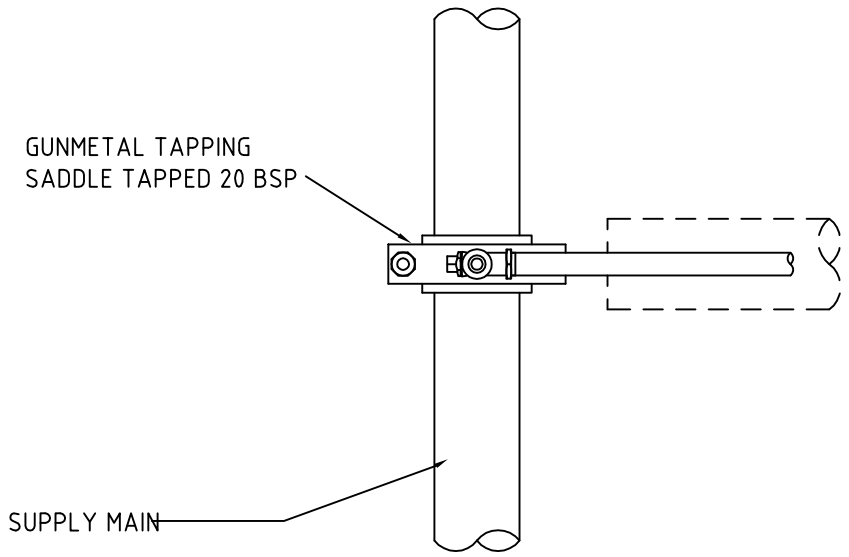

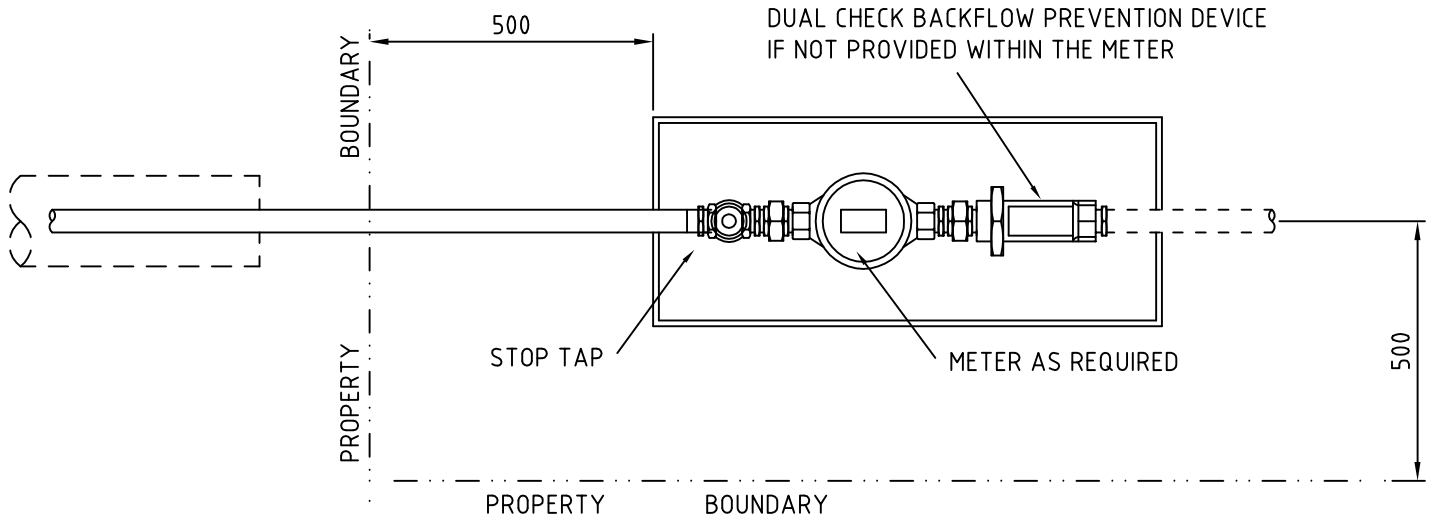

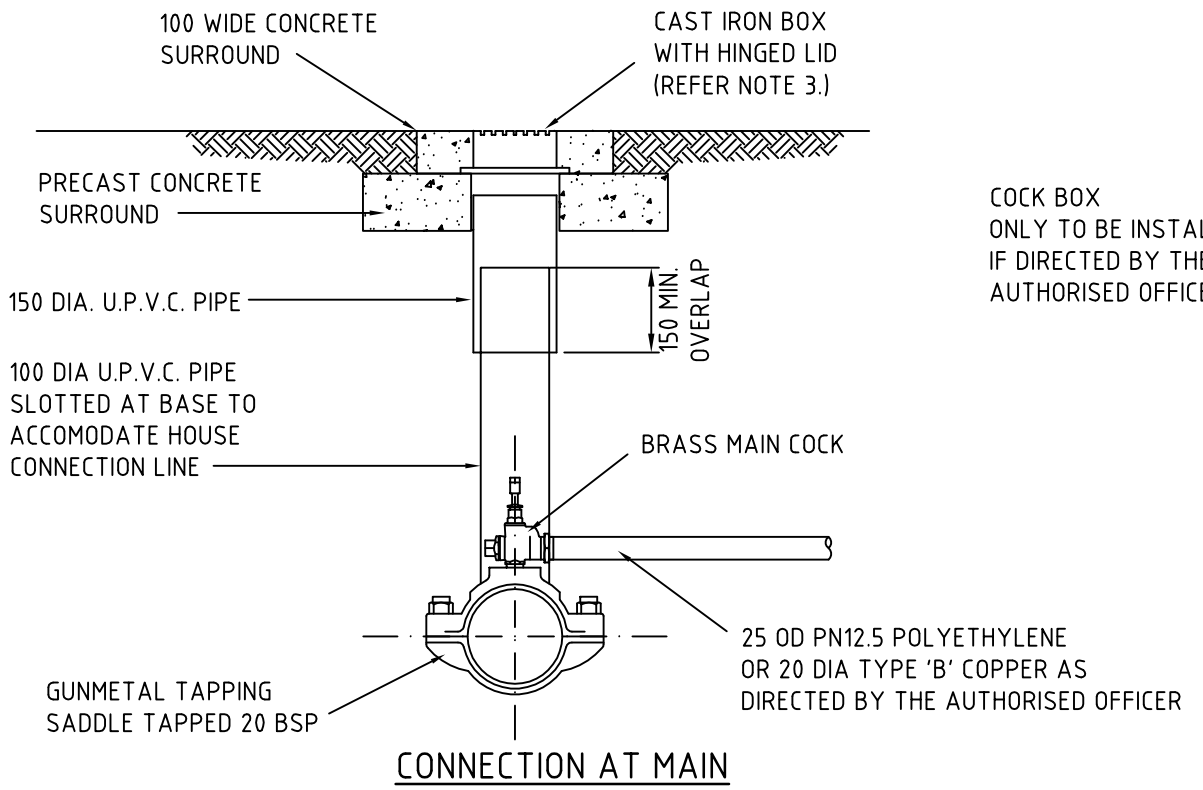

CONNECTION AT MAIN

COCK BOX
ONLY TO BE INSTALLED
IF DIRECTED BY THE
AUTHORISED OFFICER

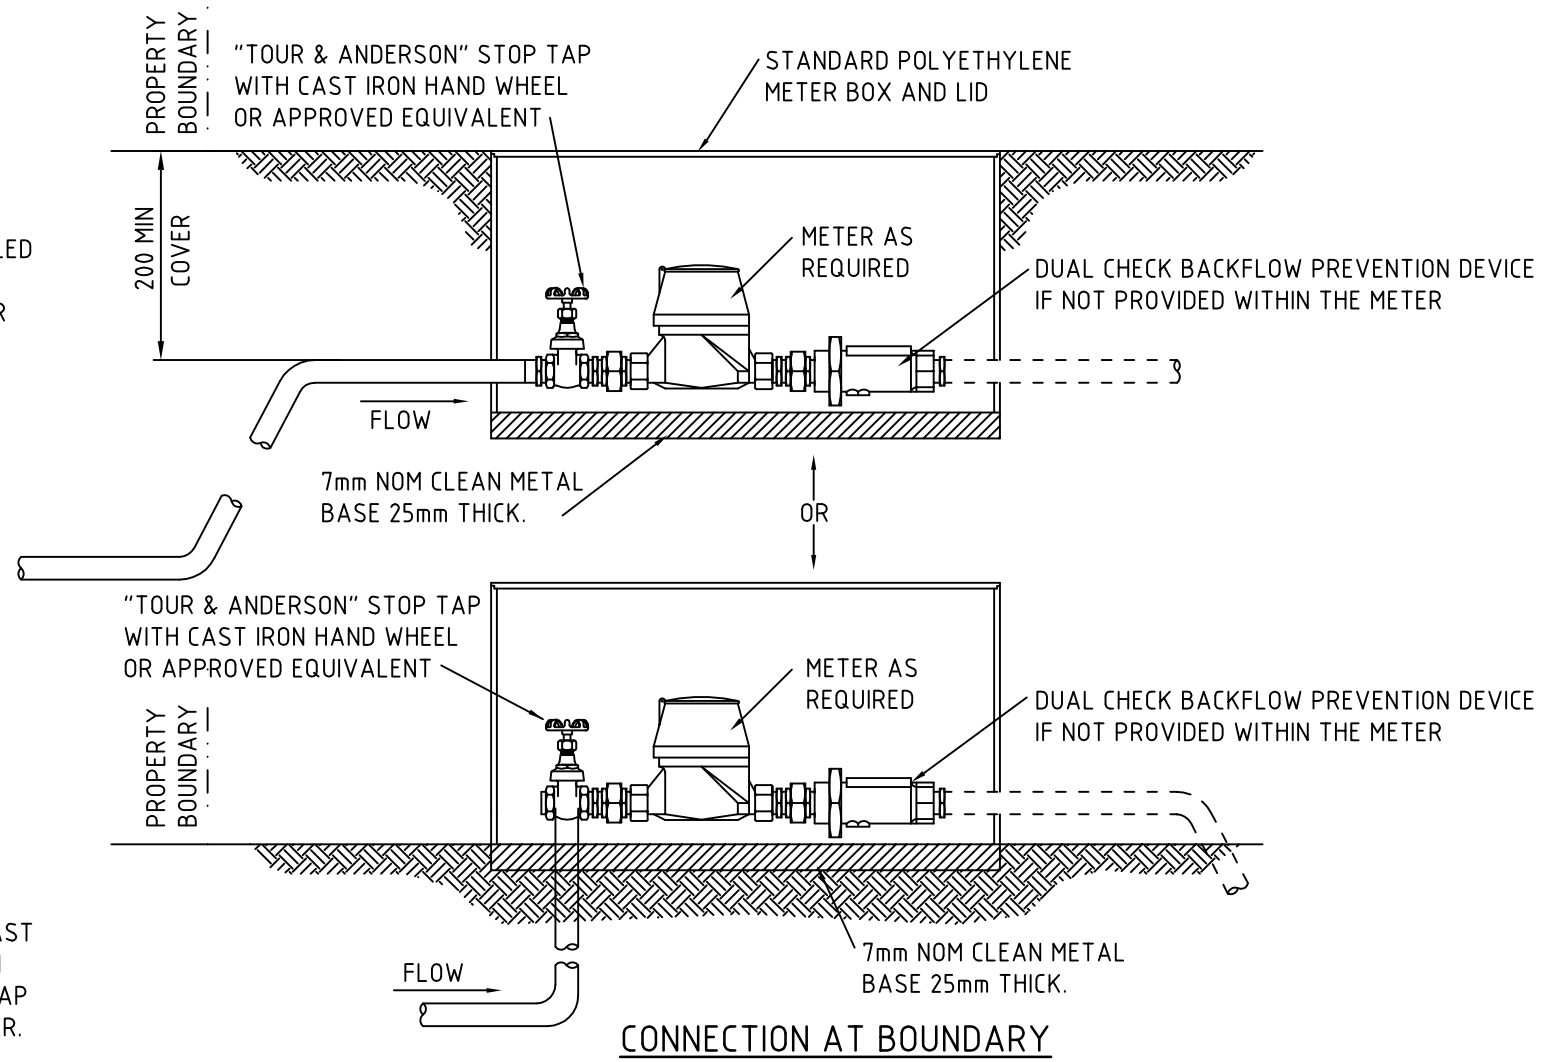

CONNECTION AT BOUNDARY

NOTES

1. ALL DIMENSIONS IN MILLIMETRES (mm).
2. MULTIPLE RESIDENTIAL, COMMERCIAL AND INDUSTRIAL CONNECTIONS SHALL BE TO THE APPROVAL OF THE AUTHORISED OFFICER.
3. IN RURAL AND SEMI RURAL SITUATIONS THE CAST IRON MAINS COCK BOX MAY BE REPLACED WITH A 150DIA UPVC END CONNECTOR AND SCREW CAP WHERE APPROVED BY THE AUTHORISED OFFICER.
4. REFER SD-1002 FOR MINIMUM COVER REQUIREMENTS.

No.	AMENDMENT	APPR.	DATE
C	NMC REVISION		07/05
B	DRAFTING REVISIONS		05/04
A	REVIEW OF STANDARD DRAWING SET		01/03

INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALIA TASMANIA DIVISION Inc. – 2003 DISCLAIMER.
The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, or consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.

INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALIA TASMANIA DIVISION

DRAWING TITLE MUNICIPAL STANDARD DRAWING

WATER SUPPLY - LOT CONNECTION
(SINGLE RESIDENTIAL)

SCALE	ISSUE DATE	APPROVED	
NOT TO SCALE	NOV. 1997		SD-4001