NOTES:

1. ALL DIMENSIONS IN MILLIMETRES (mm).
2. MINIMUM CONCRETE GRADE N20.
3. REFER SD-5001 FOR PIPE BEDDING AND BACKFILLING DETAILS.
4. ANCHOR BLOCKS TO BE USED ON ALL MAINS WHERE GRADE EXCEEDS 15% AND AT 12000 MAX CRS, OR AS DIRECTED BY THE AUTHORISED OFFICER

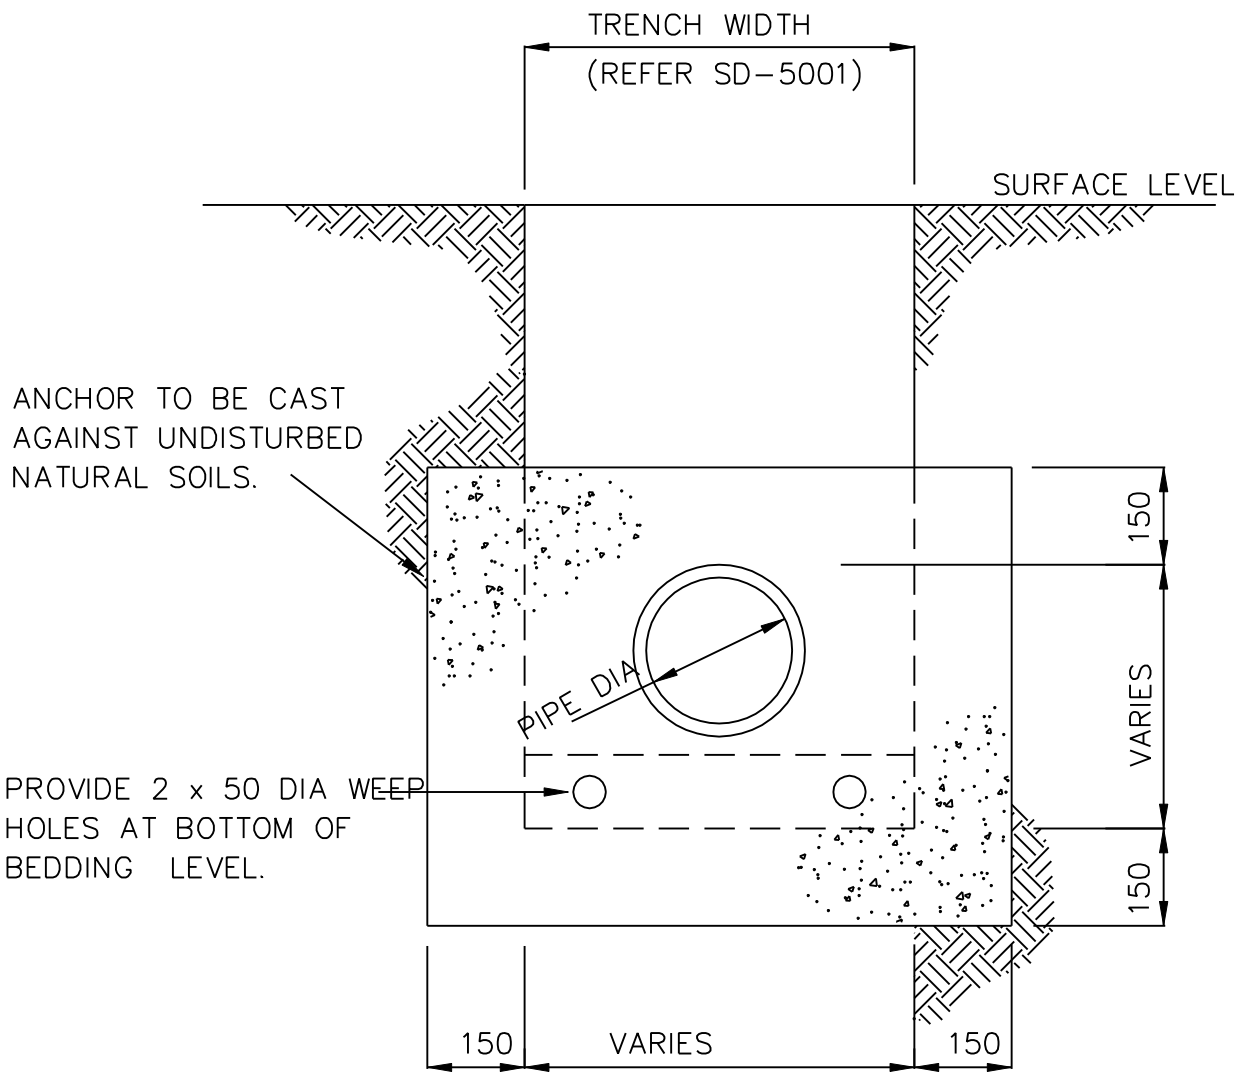

ELEVATION

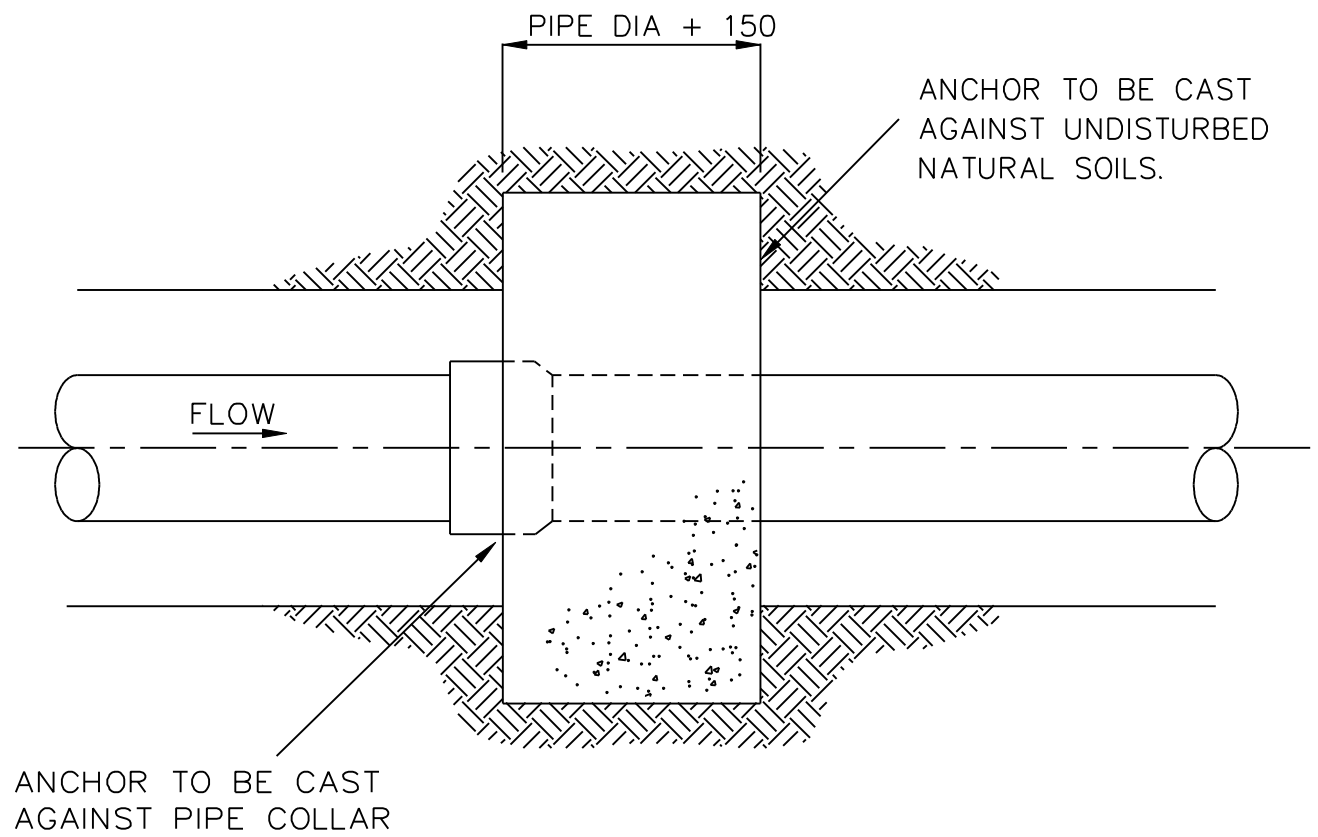

PLAN

No.	Amendment	Appr.	Date
E			
D			
C			
B			
A	REVIEW OF STANDARD DRAWING SET		01/03

INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALIA TASMANIA DIVISION Inc. – 2003 DISCLAIMER.

The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, or consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.

INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALIA TASMANIA DIVISION

Drawing Title: MUNICIPAL STANDARD DRAWING

ANCHOR BLOCK DETAILS

Scale	Issue Date	Approved	Drawing No.
NOT TO SCALE	NOV. 1997		SD-5002